


THIS DRAWING IS DESIGNED FOR TURNSTILES:

BAR-ONE
BAR-EQ } without MLU10 (≈ Basic)

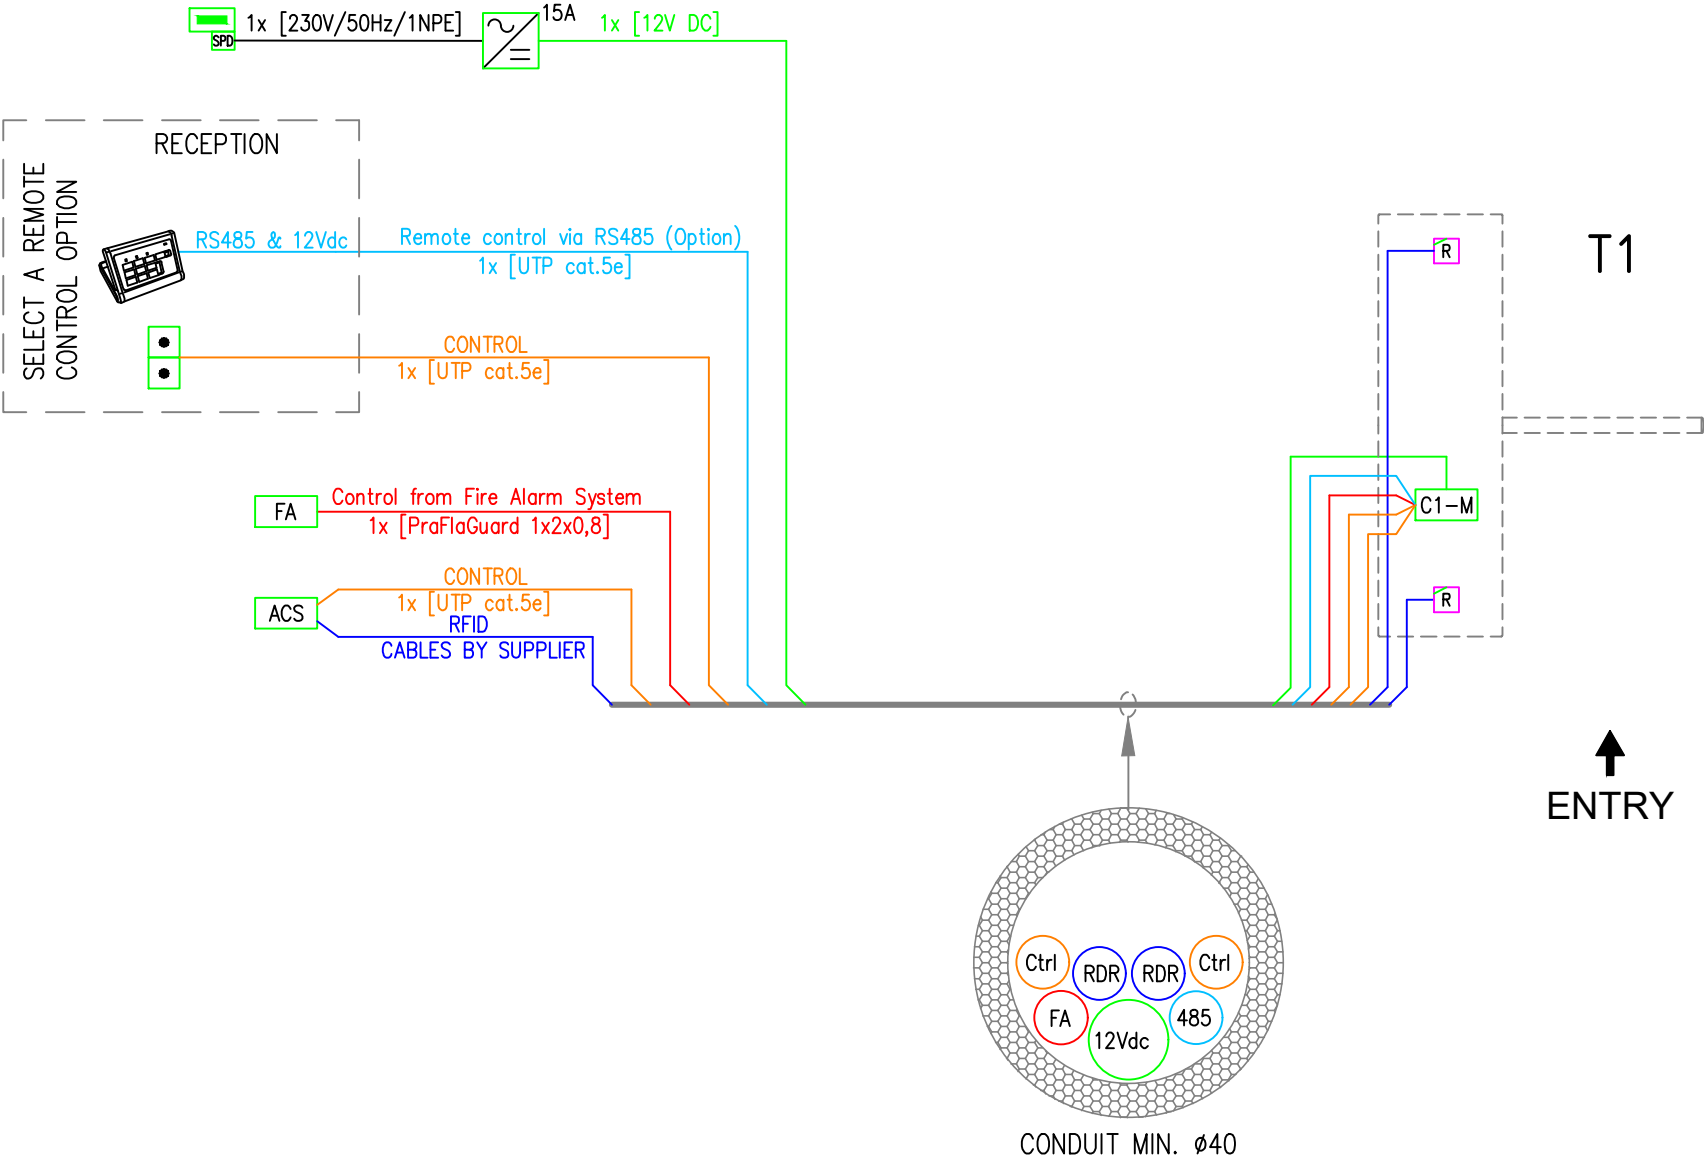

DRAWING SYMBOLS :

- 

15A POWER SUPPLY UNIT 230Vac/12Vdc, MIN. 15A, SELV (e.g. HPSB-12V15A)
- 

C1-M CONTROL ELECTRONICS AND MOTOR OF TURNSTILE T1
- 

ACS CONTROL UNIT OF ACCESS CONTROL SYSTEM
- 

FA CONTROL UNIT OR RELAY OUTPUT OF FIRE ALARM SYSTEM
- 

BOX 230V/50Hz WITH CIRCUIT BREAKER, e.g. 10A/B
- 

SPD SURGE PROTECTION DEVICE WITH HF FILTER
- 

R RFID READER
- 

CONTROL BUTTON (OPTION)
- 

TOUCH PANEL FOR TURNSTILES REMOTE CONTROL (OPTION)
- 

12Vdc POWER SUPPLY 12V DC, e.g. 2x2,5 mm2 – SEE INSTAL. MANUAL.
- 

FA CABLE FROM FIRE ALARM SYSTEM – EMERGENCY EXIT, e.g. PraFlaGuard 1x2x0,8
- 

485 RS485 LINE FOR REMOTE CONTROL, SERVICE etc., e.g. FTP cat.5e
- 

RDR RFID READER CABLES BY SUPPLIER
- 

LAN / ETHERNET, e.g. UTP cat.5e
- 

Ctrl I/O CONTROL CABLE TO TURNSTILE/GATE, e.g. UTP cat.5e

	Date	Drawed by	Material	Order No.	
	13.6.2024	Jiri Sliva			
	Size A3	Project: BAR-ONE without MLU10 (BASIC)			
Scale	Title: Power supply 12V DC – Universal wiring diagram			D.No. 22Z000S-32.1	Part/Parts